

**Subject:** GSCH005 HV Surge arresters for substations**Application Areas**Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

**CONTENTS**

1	DOCUMENT AIMS AND APPLICATION AREA .....	2
1.1	RELATED DOCUMENTS TO BE IMPLEMENTED AT COUNTRY LEVEL .....	2
2	DOCUMENT VERSION MANAGEMENT .....	2
3	UNITS IN CHARGE OF THE DOCUMENT .....	3
4	REFERENCES .....	3
5	ORGANIZATIONAL PROCESS POSITION IN THE PROCESS TAXONOMY .....	5
6	DEFINITIONS AND ACRONYMS .....	5
7	DESCRIPTION .....	6
7.1	COMPONENT LIST .....	6
7.2	SERVICE CONDITIONS.....	6
7.2.1	General services conditions .....	6
7.2.2	Specific services conditions.....	6
7.3	TECHNICAL CHARACTERISTICS .....	8
7.4	CONSTRUCTION CHARACTERISTICS.....	8
7.4.1	General characteristics .....	8
7.4.2	Specific characteristics .....	9
7.4.3	Insulators .....	9
7.4.4	HV terminals .....	9
7.4.5	Grounding .....	10
7.4.6	Protective treatments.....	10
7.4.7	Dimensional characteristics.....	10
7.4.8	Support .....	10
7.4.9	Nameplates.....	10
7.5	TESTING .....	11
7.5.1	General information .....	11
7.5.2	Type tests .....	11
7.5.3	Routine tests and acceptance tests .....	12
7.6	TECHNICAL CONFORMITY ASSESSMENT.....	13
7.7	Packing, transport, storage and installation/testing .....	13
	ANNEX A – DIMENSIONAL DRAWINGS .....	14
	ANNEX B – TENDER’S TECHNICAL DOCUMENTATION .....	15
	ANNEX C – COMPONENT LIST.....	16

THE HEAD OF NETWORK COMPONENTS  
**Fabrizio GASBARRI**

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

## 1 DOCUMENT AIMS AND APPLICATION AREA

The scope of this document is to provide technical requirements for the supply of HV surge arresters for system from 12 kV to 245 kV in the Enel Group Distribution companies, listed below:

Country	Distribution Company
Argentina	Edesur
Brazil	Enel Distribuição Rio Enel Distribuição Ceará Enel Distribuição São Paulo
Colombia	Codensa
España	e-distribución
Italy	e-distribuzione
Peru	Enel Distribución Perú
Romania	Enel Distribuție Banat Enel Distribuție Dobrogea Enel Distribuție Muntenia

Note: the indication "Latam" refers to the Enel Group Distribution companies in South America.

Some requirements are applicable only to one or more companies, therefore, depending on the destination of the surge arresters, the supplied equipment shall comply these specific requirements.

*This document shall be implemented and applied to the extent possible within the Enel Grids and Innovability Business Line and in compliance with any applicable laws, regulations and governance rules, including any stock exchange and unbundling-relevant provisions, which in any case prevail over the provisions contained in this document.*

### 1.1 RELATED DOCUMENTS TO BE IMPLEMENTED AT COUNTRY LEVEL

This document does not require implementation of further documents.

Anyway, each Enel Grids Company can issue, under the supervision of Enel Grids and Innovability Global Network Components a detailed documents, according to the provisions of the present document and in case of specific needs

## 2 DOCUMENT VERSION MANAGEMENT

Version	Date	Main changes description
01	05/07/2017	First emission
02	25/08/2021	Changes Annex C: codification E4E. Discard MT codes already in GSCC016
03	20/10/2023	Editorial Changes Error in the Rated voltage $U_r$ for the Italian codes Update of Company Name in Enel Grids Alignment to the new format Deleted Italian standard DY2052 Routine tests and acceptance tests modification

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

	Added new 245kV italian code
--	------------------------------

### 3 UNITS IN CHARGE OF THE DOCUMENT

Responsible for drawing up the document:

- Enel Grids and Innovability : Engineering and Construction / Components and Devices Design / Network Components unit.

Responsible for authorizing the document:

- Enel Grids and Innovability: Head of Network Components unit
- Enel Grids and Innovability: Head of Quality unit.

### 4 REFERENCES

- Integrated Policy for Quality, Health and Safety, Environment, anti-Bribery and Information security;
- ISO 9001- Quality Management System – Requirements;
- ISO 14001 - Environmental Management System - Requirements with guidance for use;
- ISO 45001 - Occupational Health and Safety Management System - Requirements with guidance for use;
- ISO 37001 - Anti-bribery Management System - Requirements with guidance for use;
- ISO 27001 - Information Security Management System – Requirements.
- ISO 50001 - Energy management systems - Requirements with guidance for use;
- IEC 60099-4: “Metal-oxide surge arresters without gaps for a.c. systems”
- IEC 60071-2: “Insulation co-ordination – Applications guide”
- IEC 61462: “Composite insulators: hollow insulators for use in outdoor and indoor electrical equipment”
- ISO 2178: “Non-magnetic coatings on magnetic substrates - Measurement of coating thickness - Magnetic method”
- CEI 7-6: “Requirements for checking hot galvanizing by immersion on ferrous components used in lines and electrical installations”.IEC 60507: “Artificial pollution tests on high-voltage insulators to be used on a.c. systems”
- IEC TS 60815: Selection and dimensioning of high-voltage insulators intended for use in polluted conditions

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

- IEC/TR 62271-300 High-voltage switchgear and controlgear – Part 300: Seismic qualification of alternating current circuit breakers
- ISO 1461 Hot dip galvanized coatings on fabricated iron and steel articles - Specifications and test methods
- ISO 9223 - Corrosion of metals and alloys
- ISO 12944 - Paints and varnishes - Corrosion protection of steel structures by protective paint systems

**Specific for Brasil:**

- NR-10 - SEGURANÇA EM INSTALAÇÕES E SERVIÇOS EM ELETRICIDADE

**Specific for E-distributie Banat, Dobrogea, Muntenia (Romania):**

- FT-189\_ MAT (2015) „Descarcatoare cu oxizi metalici 110 kV
- DY-557-RO Ed. 2 Statie de transformare.Descarcatoare MT cu oxizi metalici curent de descarcare 10 kV cu carcasa in material Organic cu dispozitiv de conectare
- NTE 001/03/00 Normativ privind alegerea izolației coordonarea izolației și protecția instalațiilor electroenergetice impotriva supratensiunilor (Standard on choosing insulation, insulation coordination and overvoltage protection against electric installations).

**Specific for E-Distribuzione and Italy:**

- D.Lgs n. 81 of the 9th of April 2008 and subsequent modifications
- D.Lgs 17 gennaio 2018 Aggiornamento delle “Norme tecniche per le costruzioni” (NTC2018).
- EN 1993-1-1: 2005 Eurocode 3 – Design of steel structure – Part 1-1: General rules and rules for buildings
- EN 1993-1-8:2005 Eurocode 3 – Design of steel structure – Part 1-8: Design of joints.

**Specific for e-distribución and Spain:**

- Real Decreto Riesgo Eléctrico 614/2001 sobre disposiciones mínimas para la protección de la salud y seguridad de los trabajadores frente al riesgo eléctrico
- Reglamento Electrotécnico para Baja Tensión, Real Decreto 842/2002.
- Reglamento de puntos de Medida Real Decreto 1110/2007.
- Reglamento sobre condiciones técnicas y garantías de seguridad en instalaciones eléctricas de alta tensión, Real Decreto 337/2014.

**Group Pillar References:**

- [The Code of Ethics of Enel Group](#);
- [The Enel Group Zero Corruption Tolerance Plan \(ZTC\)](#);
- [Human Rights Policy](#);
- [Organization and Management Model as per Legislative Decree No. 231/2001](#);

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

- [Enel Global Compliance Program \(EGCP\)](#).

Notes:

- The above listed reference documents shall be intended in the in-force edition at the contract date (amendment included).
- For Latin America destinations the reference standards are the IEC/ISO, whilst for Europe destinations the reference standard are the correspondent European standards (EN).

**5 ORGANIZATIONAL PROCESS POSITION IN THE PROCESS TAXONOMY**

Value Chain/Process Area: Engineering and Construction

Macro Process: Devices and Components Development

Process: Standard Catalog Management

**6 DEFINITIONS AND ACRONYMS**

Acronym and Key words	Description
<b>Continuous operating voltage of an arrester (Uc)</b>	Designed permissible r.m.s. Value of power-frequency voltage that may be applied continuously between the arrester terminals in accordance with iec 60099-4
<b>Distribución class arrester</b>	Arrester intended for use on distribution systems, typically of $U_s \leq 52$ kv, to protect components primarily from the effects of lightning.
<b>High current impulse of an arrester</b>	Peak value discharge current having a 4/10 impulse shape which is used to test the stability of the arrester on direct lightning strokes
<b>Lightning current impulse</b>	8/20 current impulse with limits on the adjustment of equipment such that the measured values are from 7 $\mu$ s to 9 $\mu$ s for the virtual front time and from 18 $\mu$ s to 22 $\mu$ s for the time to half-value on the tail
<b>Nominal discharge current of an arrester (In)</b>	Peak value of lightning current impulse which is used to classify an arrester in accordance with IEC 60099-4
<b>Protective characteristics of an arrester</b>	A combination of lightning impulse protection level (LIPL), switching impulse protection level (SIPL) and steep current impulse protection level (STIPL)
<b>Rated frequency of an arrester</b>	Frequency of the power system on which the arrester is designed to used.
<b>Rated voltage of an arrester (Ur)</b>	Maximum permissible 10 s power-frequency r.m.s. Overvoltage that can be applied between the arrester, as verified in the tov test and the operating duty test
<b>Reference voltage of an arrester (Uref)</b>	Peak value of power-frequency voltage divide by $\sqrt{2}$ , which is obtained when the reference current flows through the arrester
<b>Residual voltage of an arrester (Ures)</b>	Peak value of voltage that appears between the terminals of an arrester during the passage of discharge current
<b>Station class arrester</b>	Arresters intended for use in station to protect the equipment from transient overvoltages, typically but not only intended for use on system of $U_s \geq 72,5$ kv
<b>Steep current impulse</b>	Current impulse with a virtual front time of 1 $\mu$ s with limits in the adjustment of equipment such that the measured values are from 0,9 $\mu$ s to 1,1 $\mu$ s and the virtual time to half-value on the tail is not longer than 20 $\mu$ s.

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

<b>Switching current impulse of an arrester</b>	Peak value of discharge current a virtual front time greater than 30 $\mu$ s but less than 100 $\mu$ s and a virtual time to half-value on the tail of roughly twice the virtual front time
<b>Technical Conformity</b>	A “conformity assessment” <sup>1</sup> with respect to “specified requirements” <sup>2</sup> consists in functional, dimensional, constructional and test characteristics
<b>Technical Conformity Assessment (TCA)</b>	Required for a product (or a series of products) and quoted in technical specifications and quality requirements issued by Enel Group distribution companies. This also includes the verification of conformity with respect to local applicable regulation and laws and possession of relevant requested certifications
<b>Type A documentation</b>	Not confidential documents used for product manufacturing and management from which it is possible to verify the product conformity to all technical specification requirements, directly or indirectly
<b>Type B documentation</b>	Confidential documents used for product manufacturing and management where all product project details are described, in order to uniquely identify the product object of the TCA

## 7 DESCRIPTION

### 7.1 COMPONENT LIST

The complete list of the equipment with their main characteristics is in Annex C (Common list of HV Surge arrester)

### 7.2 SERVICE CONDITIONS

#### 7.2.1 General services conditions

The reference service conditions are the normal service conditions of IEC 60099-4, with the further indications include in 5.2.

#### 7.2.2 Specific services conditions

##### 7.2.2.1. E-Distribución

- a) Pollution level: Type d (Heavy) or type e (very Heavy)

##### 7.2.2.2. e-distribuzione and Enel Distributie

- a) Pollution level: Type d (Heavy); 43,3 mm/kV (RUSCD)
- b) Seismic qualification level: AF5 (IEC/TR 62271-300)

##### 7.2.2.3. Latam

- a) Pollution level: IEC TS 60815

<sup>1</sup> Definition 2.1 of ISO/IEC 17000

<sup>2</sup> Definition 3.1 of ISO/IEC 17000



INTERNAL

Technical Specification code: GRI-GRI-MAT-E&C-0052

Version no. 3 dated 20/10/2023

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

	AMPLA	CODENSA	COELCE	EDELNOR	EDESUR
SPS Class (IEC/TS 60815 series)	(e) Very Heavy	(c) Medium	(e) Very heavy	(e) Very Heavy	(c) Medium
RUSCD (mm/kV)	53,7	34,7	53,7	53,7	34,7

b) Altitude:

The reference altitude in Colombia is 2.600 m

c) Seismic qualification level:

- a. Codensa AF3 (IEC/TR 62271-300)
- b. Edelnor AF5 (IEC/TR 62271-300)

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

**7.3 TECHNICAL CHARACTERISTICS**

	Main voltage	Designation	Insulation level	rated frequency (Hz)	rated voltage (Ur) (kV)	continuous operating voltage (Uc) (kV)	nominal discharge current (In) (kA)	rated short-circuit current	Residual voltage for steep current impulse (kV)	Residual voltage for lightning current impulse (kV)	Residual voltage for switching current impulse (kV)	High current impulse (kA)	Rated static mechanical terminal load (daN)
e-distribución	220 kV	SM	245/395-460/950-1050	50	192	154	10	40 kA 0,2s Clase A	710	633	499	100	125
	110 kV	SM	123/230-275/550-650	50	96	77	10	1,5 kA 0,2s Clase A	355	317	249	100	100
	132 kV	SM	145/230-275/550-650	50	120	92	10	1,5 kA 0,2s Clase A	444	396	312	100	100
	50 kV	SM	52/140/325	50	53	42	10	1,5 kA 0,2s Clase A	196	175	138	100	50
	66 kV	SM	72,5/140/325	50	60	48	10	1,5 kA 0,2s Clase A	222	198	156	100	50
	45 kV	SL	52/95/250	50	42	34	10	25 kA 0,2s Clase A	155	138	109	100	100
	Neutro Trafo 220	SM	245/275/650	50	146	117	10	40 kA 0,2s Clase A	540	483	380	100	125
	Neutro Trafo 110	SM	123/275/650	50	75	60	10	1,5 kA 0,2s Clase A	278	254	195	100	100
	Neutro Trafo 132	SM	245/275/650	50	84	67	10	1,5 kA 0,2s Clase A	310	276	218	100	100
	Neutro Trafo 55	SM	72,5/140/325	50	38	30	10	1,5 kA 0,2s Clase A	139	127	98	100	50
Neutro Trafo 66	SM	72,5/140/325	50	42	34	10	1,5 kA 0,2s Clase A	155	142	109	100	50	
e-distribuzione	132 kV	SL	132/450/750	50	118	94	10	31,5 kA	386	336	270	100	200
	150 kV	SL	150/450/750	50	138	110	10	31,5 kA	455	396	318	100	200
	252 kV	SL	395/460/950	50	218	156	10	40 kA	520	600	440	100	200
ENEL Rom	110 kV	SL	123/230/550	50	96	72	10	40 kA	310	280	220	100	200
	Neutro trafo 110	SL	123/185/450	50	57	45,5	10	40 kA	222	200	190	100	200
CODENSA	220 kV	SM	245/460/950	60	192	152	10	40 kA	489	452	381	100	200
	115 kV	SL	123/230/550	60	96	76	10	40 kA	266	226	185	100	200
	34,5 kV	SL	36/70/145	60	30	24	10	25 kA	81,2	100	78	100	50
	13,2-11,4 kV	SL	17,5/38-28/95-95	60	12	8,7	10	25 kA	35,1	40	32,8	100	50
Enel Perú	220 kV	SM	245/460/1050	60	198	154	10	40 kA	554	502	455	100	125
	69 kV	SL	72,5/140/325	60	60	48	10	40 kA	170	160	126	100	100
EDESUR	220 kV	SH	245/395/950	50	198	154	20	40 kA	-	502	455	100	125
	132 kV	SM	245/230/550	50	120	92	10	40 kA	-	310	270	100	100
Enel Río	138 kV	SM	145/275/650	60	120	92	10	40 kA	-	310	270	100	100
	69 kV	SL	72,5/140/325	60	60	48	10	31,5 kA	-	200	150	100	50
	34,5 kV	SL	36/70/170	60	30	24	10	25 kA	-	100	78	100	50
	13,8 kV-11,95 kV	SL	17,5/38/95	60	12	10	10	25 kA	-	40	32,8	100	50
Enel Ceará	69 kV	SL	72,5/140/350	60	60	48	10	25 kA	-	200	150	100	50
	13,8 kV	SL	17,5/38/110	60	12	10	10	25 kA	-	40	32,8	100	50
ENEL SP	34,5	SL	36/70/150	60	27	22	10	40	85	97	75	100	50
	138	SM	145/275/650	60	120	92	10	40	378	350	260	100	120

**7.4 CONSTRUCTION CHARACTERISTICS**

**7.4.1 General characteristics**

The surge arresters shall be manufactured in accordance with IEC 60099-4. The dimensional drawings, for E-distribuzione e E-distributie, are in annex A.

The support, quoted separately, shall be always supplied when a seismic qualification level is required (see 7.2), otherwise it's an optional supply; the characteristics of the supports are described in the "Annex A".



**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

If interface plates and other accessories are necessary to adapt the support to the civil works, they shall be included in the supply of the support and shall be preliminary approved by Enel Group Distribution companies.

The HV surge arrester must be mounted on an insulating base, in order to isolate from earth, for connecting to surge counters and for measuring the surge arresters of the leakage current.

All codes include surge counter except for Brasil.

For Brazil the surge counters are an optional supply for HV arresters, but all arresters shall be mounted on an insulating base or bracket, in order to isolate from earth.

If it's necessary a grading ring to modify electrostatically the voltage distribution along the arrester, it shall be included in the supply.

The normal use, control and maintenance operations shall be performed with total workers safety.

**7.4.2 Specific characteristics**

*7.4.2.1. E-Distribución*

The surge arrester shall be performed in one unit until 145 kV, and shall be performed in two units for higher voltages. Always, it makes in a unique column.

*7.4.2.2. E-distribuzione and E-distributie*

The surge arrester could be performed in one or more units connected in series. Always it makes in a unique column.

*7.4.2.3. Latam*

The surge arrester could be performed in one or more units connected in series. Always in a unique column.

**7.4.3 Insulators**

The insulators are requested by Enel Group Distribution companies in composite materials.

They shall be in light grey color and compliant with IEC 61462. The envelope shall be made of silicone rubber, HTV type (High Temperature Vulcanized) or LSR type (Liquid Silicone Rubber) and completely free of EPDM or other organic rubbers.

The creepage distance must comply with IEC60815-2 and IEC 60815-3 part. 9.7 with no deviations

**7.4.4 HV terminals**

*7.4.4.1. E-Distribución and Latam*

The HV terminal shall be realized with corrosion resistant copper or aluminum alloy, in order to be interfaced with aluminum alloy clamps.

The HV terminals shall be compliant with fig. 3 (2x2 hole pattern) of IEC/TR 62271-301.

A (mm)	B (mm)	C (mm)
44,5	44,5	14,3

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

**7.4.4.2. E-distribuzione and E-distributivie**

The HV terminal shall be realized with corrosion resistant copper or aluminum alloy, in order to be interfaced with aluminum alloy clamps.

The HV terminals shall have  $\varnothing 40 \pm 0,25 \times 80$  min (mm) (fig. 1 of IEC/TR 62271-301) dimensions.

**7.4.5 Grounding**

The manufacturer shall ensure the equi-potentiality between all parts forming the equipment.

At the base of each support upright two grounding points shall be provided, equipped with M12 stainless steel bolts (included in the supply).

If interface plates are necessary to adapt the support to the civil works, they shall be designed taking into account the position of the external grounding connections.

**7.4.6 Protective treatments**

All external surfaces shall have an effective and enduring anti-corrosion protection.

All iron parts (e.g. support, Control Box, bolts etc.) shall be in non-corrosive material or hot dip galvanized in compliance with ISO 1461. All processing shall be completed before the protective treatments.

Protective treatments alternative to the hot dip galvanization could be accepted if the manufacturer prove its fitness.

The metallic elements in contact between them shall be designed to avoid corrosion due to humidity galvanic effect.

**7.4.6.1. Latam specific requirements.**

In Brazil (E. Rio, E. Ceará, E. Goiás and E. Sao Paulo) and Perú (Edelnor) there is atmospheric corrosive environments "Very High" (C5- ISO 9223 and ISO 12944). Thus, control boxes or cabinets, bolts, etc.. shall be made of stainless steel.

**7.4.7 Dimensional characteristics**

Specific dimensional requirements are shown in Annex A.

**7.4.8 Support**

The support is an optional supply.

**7.4.9 Nameplates**

The nameplates shall be in stainless steel. Alternative materials can be considered if the manufacturer proves the marking endurance respect to the ageing (this solution shall be approved by Enel Distribution companies).

In accordance with IEC 60099-4, nameplates shall include:

- a) The manufacturer's name or trade mark, type and identification of the complete arrester;
- b) Serial number;
- c) The year of manufacture;

**Subject:** GSCH005 HV Surge arresters for substations**Application Areas**Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

- d) Type code of Enel;
- e) Rated voltage;
- f) Continuous operating voltage;
- g) Rated frequency;
- h) Nominal discharge current;
- i) Rated short-circuit withstand current in kiloamperes (kA)
- j) Designation
- k) Contamination withstand level of the enclosure.

## 7.5 TESTING

### 7.5.1 General information

The tests will be performed according to Standards 60099-4.

The tests to be performed on surge arrester are divided in:

- Type tests;
- Routine tests and acceptance tests;
- Test requirements on polymer-housed surge arrester

### 7.5.2 Type tests

7.5.2.1. *Insulation withstand tests on arrester housing.*

(IEC 60099-4, par. 10.8.2)

7.5.2.2. *Residual voltage tests*

(IEC 60099-4, par. 10.8.3)

7.5.2.3. *Test to verify long term stability under continuous operating voltage*

(IEC 60099-4, par. 10.8.4)

7.5.2.4. *Test to verify the repetitive charge transfer rating, Qrs*

(IEC 60099-4, par. 10.8.5)

7.5.2.5. *Heat dissipation behavior of test sample*

(IEC 60099-4, par. 10.8.6)

7.5.2.6. *Operating Duty tests*

(IEC 60099-4, par 10.8.7)

7.5.2.7. *Power frequency voltage versus time test*

(IEC 60099-4, par. 10.8.8)

7.5.2.8. *Short-circuit tests*

(IEC 60099-4, par. 10.8.10)

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

**7.5.2.9. Test of the bending moment**

(IEC 60099-4, par. 10.8.11)

**7.5.2.10. Environmental tests**

(IEC 60099-4, par. 10.8.12)

**7.5.2.11. Radio interference voltage (RIV) test**

(IEC 60099-4, par. 10.8.14)

**7.5.2.12. Test to verify the dielectric withstand of internal components**

(IEC 60099-4, par. 10.8.15)

**7.5.2.13. Test of internal grading components**

(IEC 60099-4, par. 10.8.16)

**7.5.2.14. Weather ageing test**

(IEC 60099-4, par. 10.8.17)

**7.5.3 Routine tests and acceptance tests**

**7.5.3.1. Routine tests**

(IEC 60099-4, par. 9.1)

To be performed autonomously by the Supplier, on each produced arrester.

The test results must be recorded and made available in case of Acceptance tests in the presence of an Enel delegate.

**7.5.3.2. Acceptance tests**

(IEC 60099-4, par. 9.2)

To be performed by the Supplier in case of presence of an Enel delegate on the sample (defined by IEC 60099-4 – par. 9.2.) according to the numerosity of each Enel code of arrester submitted to FAT.

(The number of arresters to be tested will be the nearest lower whole number to the cube root of the number of arresters to be supplied).

In addition to the tests required by the IEC 60099-4, par. 9.2, the following tests should also be carried out with the same sample plan:

**A. Control of constructive correspondence to the approved prototype;**

(If the supply also includes arrester supports, these must also be subject to this check)

**B. Verification of the outer protective coating of metal parts (where applicable):**

(If the supply also includes arrester supports, these must also be subject to this check)

The galvanic and paint thickness shall be verified using the magnetic method test, according to ISO 2178.

**C. Verification of hollow insulators:**

The manufacturer must make available the certificates of origin of the raw materials and the reports of tests carried out autonomously in accordance with IEC 61462 for composite coating.

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

---

## 7.6 TECHNICAL CONFORMITY ASSESSMENT

The Technical Conformity Assessment will carry out in accordance with Global Standard GSCG002.

## 7.7 Packing, transport, storage and installation/testing

The surge arrester package shall be suitable to guarantee:

- a) the protection during transport (including by ship, if necessary);
- b) an elevation from the ground at least of 100 mm;
- c) the external storage for at least three months.

On external side of packaging, the following information shall be present

- a) manufacturer name;
- b) manufacturing year/month;
- c) manufacturer designation type;
- d) manufacturer serial number;
- e) Enel component codification (i.e.: GSCH005/1 - 0505X);
- f) contract number;
- g) destination substation;
- h) total weight;
- i) lifting information (showing the points and the correct method of lifting);
- j) bar code, in accordance with CNS-O&M-S&L-2021-0032-EGIN.

With each surge the following items shall be supplied in the local language of destination (items from d to f on paper):

- a) the support structure (only if requested) with its anchor bolts to the civil works (stainless or hot dip galvanized steel, chemical or expansion type);
- b) bolts to assembly the Surge Arrester to support structure
- c) list of documentation, materials and accessories supplied;
- d) overall dimensions drawing;
- e) surge arrester installation, use and maintenance handbook/manual;
- f) routine and commissioning tests:
  - a. routine (factory) test reports;
  - b. reference values table (with tolerances);

### 7.7.1.1. Specific requirement for e-distribución

The manufacturer must present the declaration of conformity in compliance with ITC-RAT 03 of the "Reglamento sobre condiciones técnicas y garantías de seguridad en instalaciones eléctricas de alta tensión, Real Decreto 337/2014." in local language

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*


Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

**ANNEX A – DIMENSIONAL DRAWINGS**

A.1 – E-distribuzione – E-distributie

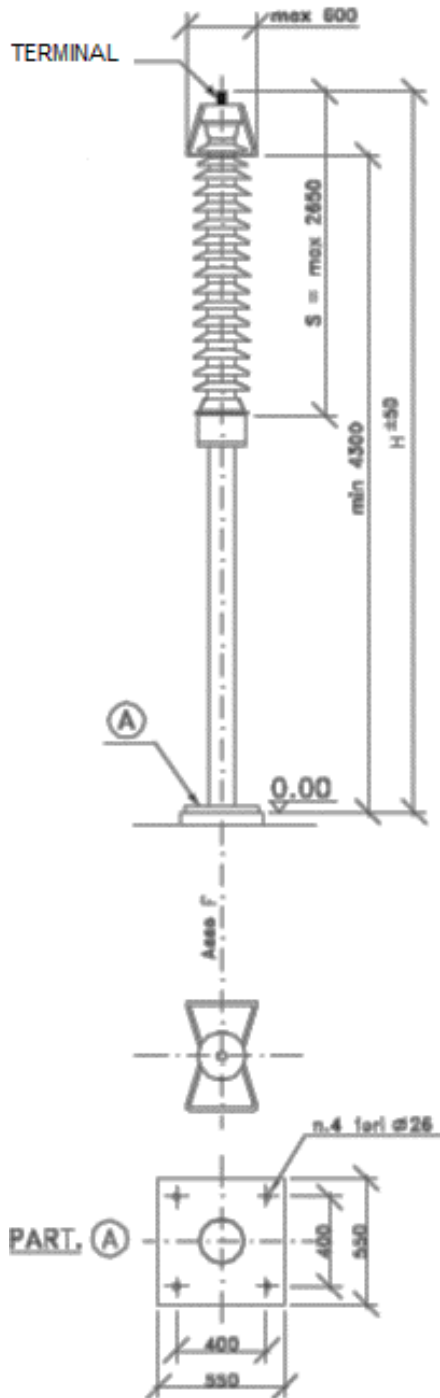

SURGER ARRESTERS SUPPORT

MATRICOLA	22 12 80	H = 5530	h = H-S
MATRICOLA	22 12 81	H = 6430	h = H-S



TERMINAL OF THE ARRESTERS



INTERNAL

Technical Specification code: GRI-GRI-MAT-E&amp;C-0052

Version no. 3 dated 20/10/2023

**Subject:** GSCH005 HV Surge arresters for substations**Application Areas**Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability***ANNEX B – TENDER'S TECHNICAL DOCUMENTATION**

<b>GLOBAL STANDARD:</b> GSH05X – HV Surge Arresters	<b>TENDER:</b>	
<b>SUPPLIER:</b>	<b>FACTORY:</b>	
<b>ENEL GROUP TYPE CODE:</b> GSH05X/___	<b>SUPPLIER MODEL:</b>	
<b>TECHNICAL CHARACTERISTIC</b>	<b>STANDARD REQUIREMENT</b>	<b>SUPPLIER OFFER</b>
<i>Service conditions</i>	normal service conditions of IEC 60099-4	
<i>Reference altitude (m)</i>	< 1.000 (2.850 for Colombia)	
<i>SPS Class (IEC/TS 60815 series)</i>	d) or e)	
<i>Ice coating (mm)</i>	10 (22 for Romania)	
<i>Seismic qualification level</i>	See 7.2.2	
<i>Rated voltage</i>	See table in 7.3	
<i>Rated frequency fr (Hz)</i>	50 or 60	
<i>Continuous operating voltage (kV)</i>	See table in 7.3	
<i>Nominal discharge current (kA)</i>	See table in 7.3	
<i>Rated short-circuit current (kA)</i>	See table in 7.3	
<i>Residual voltage for steep current impulse (kV)</i>	See table in 7.3	
<i>Residual voltage for lightning current impulse (kV)</i>	See table in 7.3	
<i>Line discharge class</i>	See table in 7.3	
<i>Residual voltage for switching current impulse (kV)</i>	See table in 7.3	
<i>High current impulse (kA)</i>	See table in 7.3	
<i>Long-duration current impulse (2400 us)</i>	See table in 7.3	
<i>Rated static mechanical terminal load (daN)</i>	See table in 7.3	
<i>Dimensions</i>	See Annex A	To enclose an overall equipment drawing for each Enel Group Distribution Company

**Subject:** GSCH005 HV Surge arresters for substations

**Application Areas**

Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

**ANNEX C – COMPONENT LIST**

Type code	Company	Company code	TAM Company code	Highest system voltage (kV)	Designation	Rated frequency (Hz)	Rated voltage (Ur); (kV)	Continuous operating voltage (Uc); (kV)	Nominal discharge current (In); (kA)	Pollution level (mm)	Housed
GSCH005/001	EDE	6701231	170023	245	SM	50	192	154	10	6125	polymer
GSCH005/002	EDE	6701232	170024	145	SM	50	120	92	10	3625	polymer
GSCH005/003	EDE	6701233	170025	123	SM	50	96	77	10	3625	polymer
GSCH005/004	EDE	6701234	170026	72,5	SM	50	60	48	10	1813	polymer
GSCH005/005	EDE	6701235	170027	60	SM	50	53	42	10	1813	polymer
GSCH005/006	EDE	6701236	170028	52	SL	50	42	34	10	1300	polymer
GSCH005/007	EDE	6701749	170029	245	SM	50	146	117	10	3625	polymer
GSCH005/008	EDE	6701750	170120	123	SM	50	75	60	10	3625	polymer
GSCH005/009	EDE	6701751	170121	145	SM	50	84	67	10	3625	polymer
GSCH005/010	EDE	6701752	170122	72,5	SM	50	42	34	10	1813	polymer
GSCH005/011	EDE	6701753	170123	60,5	SM	50	38	30	10	1813	polymer
GSCH005/012	EDE	6704914	170092	245	SM	50	192	154	10	7595	polymer
GSCH005/013	EDE	6705241	170093	245	SM	50	146	117	10	4495	polymer
GSCH005/014	EDE	6705242	170094	145	SM	50	120	92	10	4495	polymer
GSCH005/015	EDE	6705243	170095	145	SM	50	84	67	10	4495	polymer
GSCH005/016	EDE	6705244	170096	123	SM	50	96	77	10	4495	polymer
GSCH005/017	EDE	6705245	170097	123	SM	50	75	60	10	4495	polymer
GSCH005/018	EDE	6705246	170098	72,5	SM	50	60	48	10	2248	polymer
GSCH005/019	EDE	6705247	170099	72,5	SM	50	42	34	10	2248	polymer
GSCH005/020	EDE	6705248	170110	60	SM	50	53	42	10	2248	polymer
GSCH005/021	EDE	6705249	170111	60,5	SM	50	38	30	10	2248	polymer
GSCH005/022	EDE	6705250	170112	52	SL	50	42	34	10	1612	polymer
GSCH005/023	EDE	6706805	170040	Surge counter	-	50	-	-	-	-	-
GSCH005/100	E-DIST.	170105	170105	145	SL	50	118	94	10	-	polymer
GSCH005/101	E-DIST.	170135	170135	170	SL	50	138	110	10	-	polymer
GSCH005/102	E- DIST.	221280	221280	Support	-	-	-	-	-	-	-
GSCH005/103	E- DIST.	221281	221281	Support	-	-	-	-	-	-	-
GSCH005/104	E- DIST.		170018	252	SL	50	218	156	10	4495	polymer
GSCH005/200	Enel Rom	617303		123	SL	50	96	72	10	3625	polymer
GSCH005/201	Enel Rom	617304		123	SL	50	57	45,5	10	3625	polymer
GSCH005/300	ENEL RIO	4545929	170973	36	SL	60	30	24	10	34,7 kVmm/kV	Polymer
GSCH005/301	ENEL RIO	4545932	170974	72,5	SL	60	60	48	10	34,7 kVmm/kV	Polymer
GSCH005/302	ENEL RIO	4545944	170977	15	SL	60	12	10	10	34,7 kVmm/kV	Polymer
GSCH005/303	ENEL RJ/SP	4660197 (RJ) 312174 (SP)	820114 (RJ)	145	SM	60	120	92	10	34,7 kVmm/kV	Polymer





INTERNAL

Technical Specification code: GRI-GRI-MAT-E&amp;C-0052

Version no. 3 dated 20/10/2023

**Subject:** GSCH005 HV Surge arresters for substations**Application Areas**Perimeter: *Global*

Staff Function: -

Service Function: -

Business Line: *Enel Grids and Innovability*

GSCH005/304	ENEL RJ/CE	12845 (SP) 4692337 (CE,RJ)		Surge counter	-	50	-	-	-	-	-
GSCH005/400	ENEL CEARA	6771010	171073	15	SL	60	12	10	10	>=560	Polymer
GSCH005/401	ENEL CEARA	6771008	171072	72,5	SL	60	60	48	10	>=2139	Polymer
GSCH005/500	CODENSA			220	SM	60	192	152	10	6625	Polymer
GSCH005/501	CODENSA	6787485	170903	115	SL	60	96	76	10	4370	Polymer
GSCH005/502	CODENSA	6787483	170901	13,2-11,4	SL	60	12	8,7	10	765	Polymer
GSCH005/503	CODENSA	6787484	170902	34,5	SL	60	30	24	10	1029	Polymer
GSCH005/600	EDELNOR	6757563	230812	245	SM	60	198	158	10	7595	polymer
GSCH005/601	EDELNOR	6800940	170812	72,5	SL	60	60	48	10	2248	polymer
GSCH005/700	EDESUR	0108- 0563		145	SM	50	120	90	10	34,7 mm/kV	Polymer
GSCH005/701	EDESUR	0108- 0564		245	SH	50	198	150	20	34,7 mm/kV	Polymer
GSCH005/900	ENEL SAO PAOLO	312124 (SP)	-	36	SM	60	27	22	10	34,7 mm/kV	Polymer